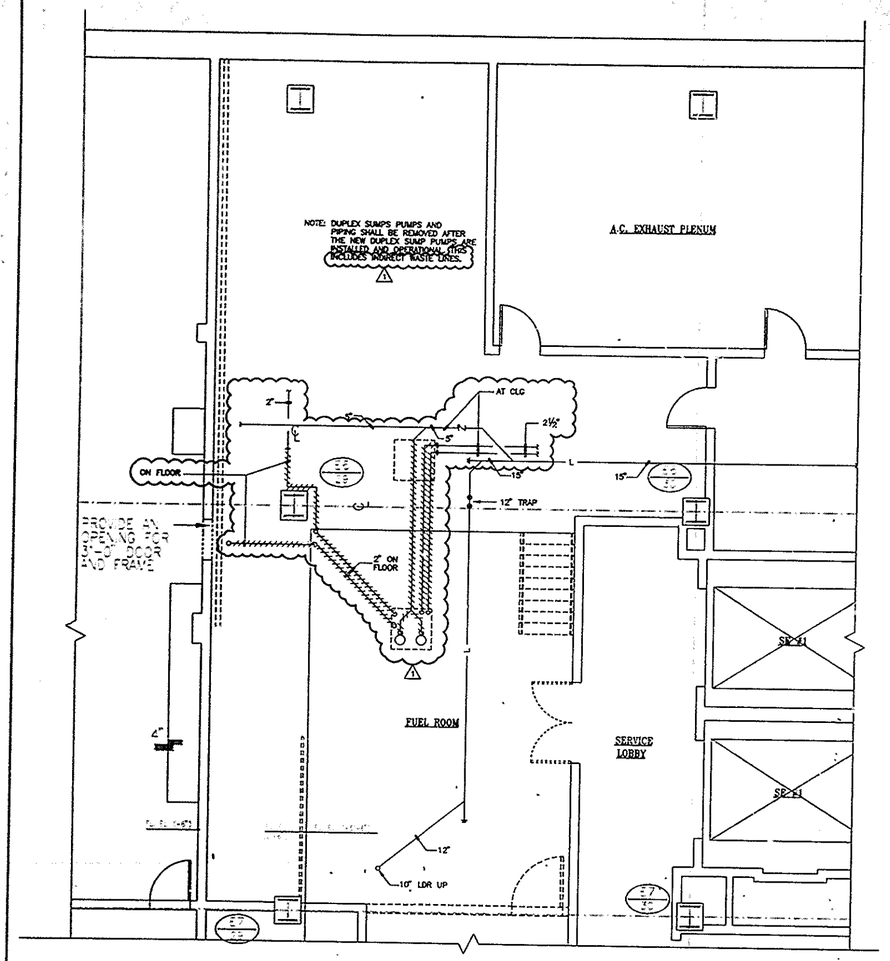

REMOVAL PLAN
FUEL OIL TANK ROOM

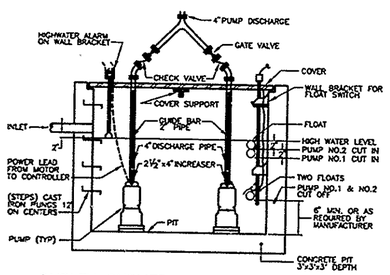

DUPLEX SUBMERSIBLE SUMP PUMPS
NOT TO SCALE

NOTES:
1. CONTROL PANEL WITH NEMA 1 ENCLOSURE SHALL BE INSTALLED WHERE SHOWN.
2. STEEL BASIN COVER SHALL BE A GRATING WITH OPENINGS AS REQUIRED FOR DISCHARGE PIPING, INLET PIPING (SAME AS FOR EXISTING SUMP PIT) AND CONTROLS.
3. EACH PUMP SHALL BE AS FOLLOWS: 100 GPM, 30 FT.H.D. 1750 RPM, 1½ HP, 460 VOLTS, 3 PH, 60 HZ., FEDERAL PUMP CORP. MODEL VSS-2½D-1½-4.

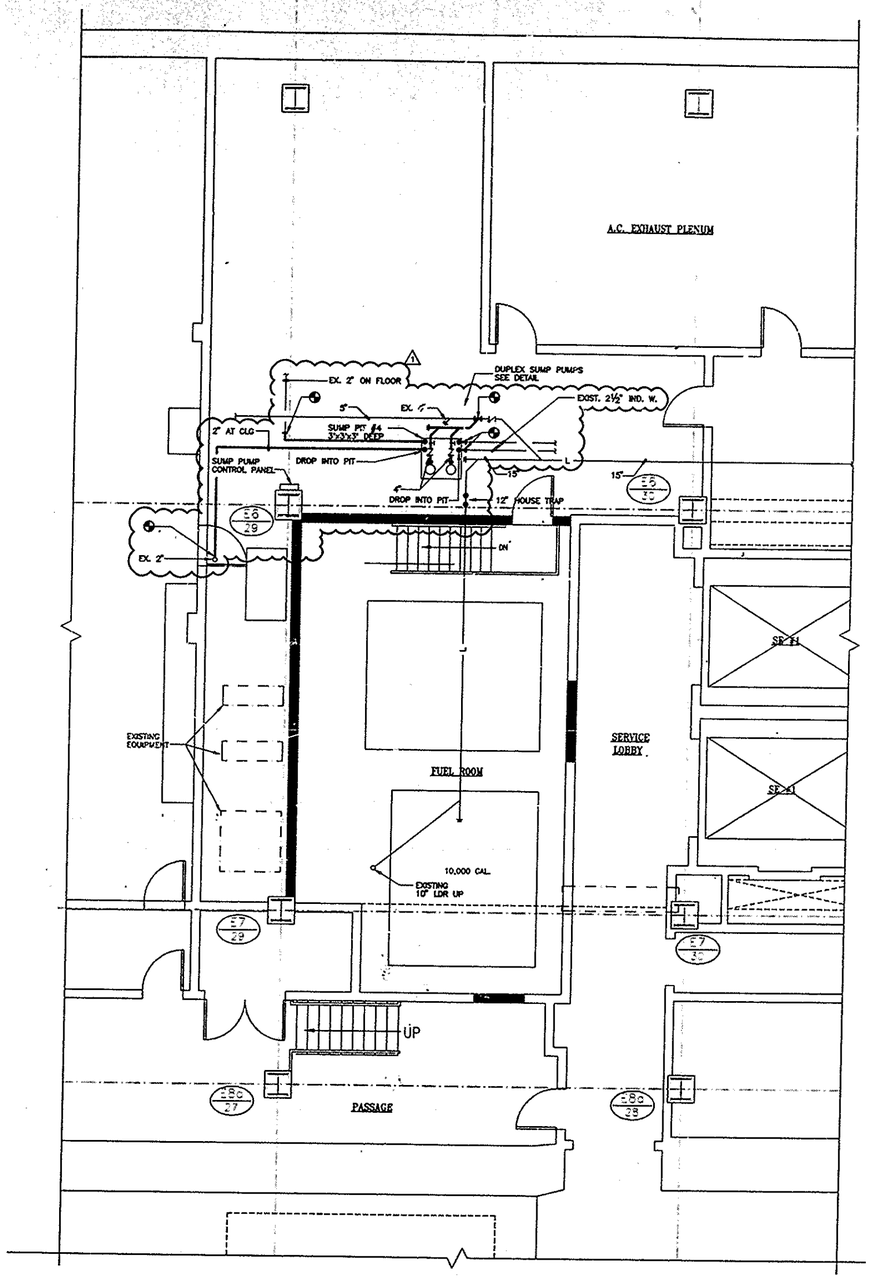

5 WTC PART PLAN B2 LEVEL
FUEL OIL TANK ROOM



Sheet 86 of 112

THE PORT AUTHORITY OF NY & NJ

ORIGINAL SIGNED & SEALED BY N.Y. P.E. (OR R.A.)

Joseph R. Loring & Associates, Inc.
consulting engineers
One Pennsylvania Plaza
New York, New York 10123-0245
Tel: (212) 563-7400, fax: (212) 563-7382

THE OFFICE OF DAVID ELLIOT LEBOWITZ PC
ARCHITECTS - PLANNERS
50 WEST 23rd STREET, NEW YORK NY 10010
TEL 212.243.2100 FAX 212.243.2108

LESLIE E ROBERTSON ASSOCIATES, P.L.L.P.
CONSULTING STRUCTURAL ENGINEERS
250 EAST 40TH STREET
NEW YORK, NY 10016-8000
TEL 212.682.8000 FAX 212.682.8005

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-945.071 IN THE FORM IN WHICH SUCH DRAWINGS EXISTED AT THE TIME THE CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 4/16/98 — SPECIFIWRITER
DATE 4/10/98 — ENGINEER OF DESIGN

No.	Date	Revision	Approved
2	12/12/97	REMOVE IND. W. & RELOCATE	
1	11/17/97	ISSUED FOR BID	

Engineering Department
Design Divisions

The World Trade Center

Title
STANDBY POWER
5 WORLD TRADE CENTER

PLUMBING

5 WTC PART PLAN
FUEL OIL TANK ROOM

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

VP	M.A.R.	VP
Designed by	Drawn by	Check by

Date 11/17/97 — Scale AS SHOWN

Contract Number WTC-945.071 — Drawing Number P2-01